



DADOS SOBRE A BOMBA DE RECALQUE				
H (m)	RECALQUE ϕ (POL.)	ALT. MAN. (m.c.o)	VAZÃO (m³/h)	POTENCIA (HP)
11.50	1.1/4"	14.50	4.0	1.0

TABELA DE ALTURAS DOS RESERVATÓRIOS	
Capacidade (m³)	hR (m)
10	2,50
15	4,00
20	5,00
25	6,00


CONSIDERANDO ϕ EXT. = 2,50m

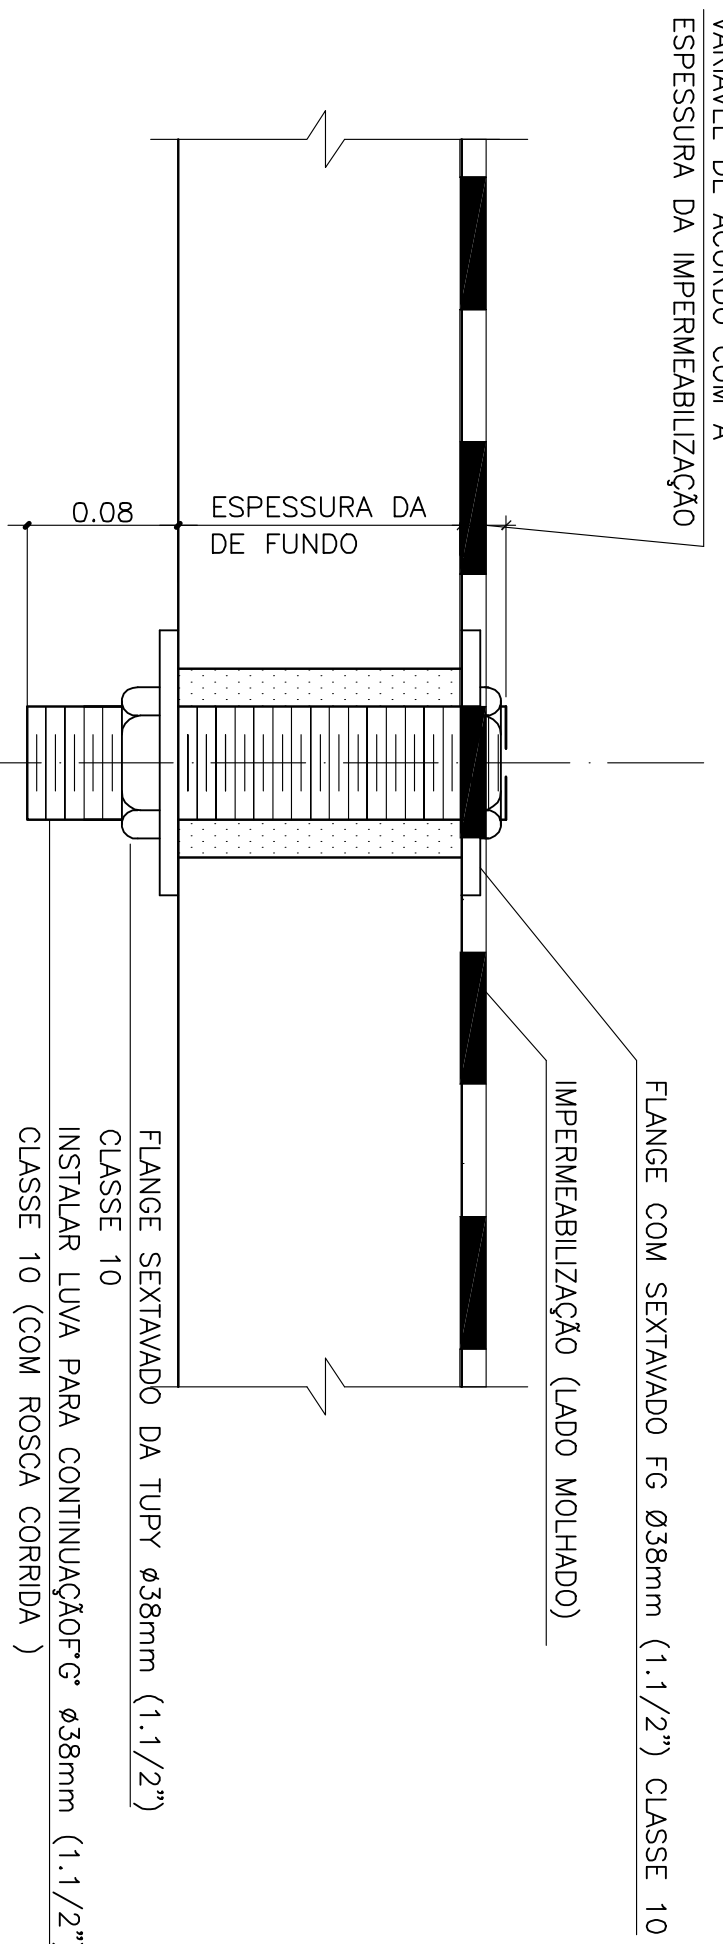


PLANTA DO RESERVATÓRIO SUPERIOR

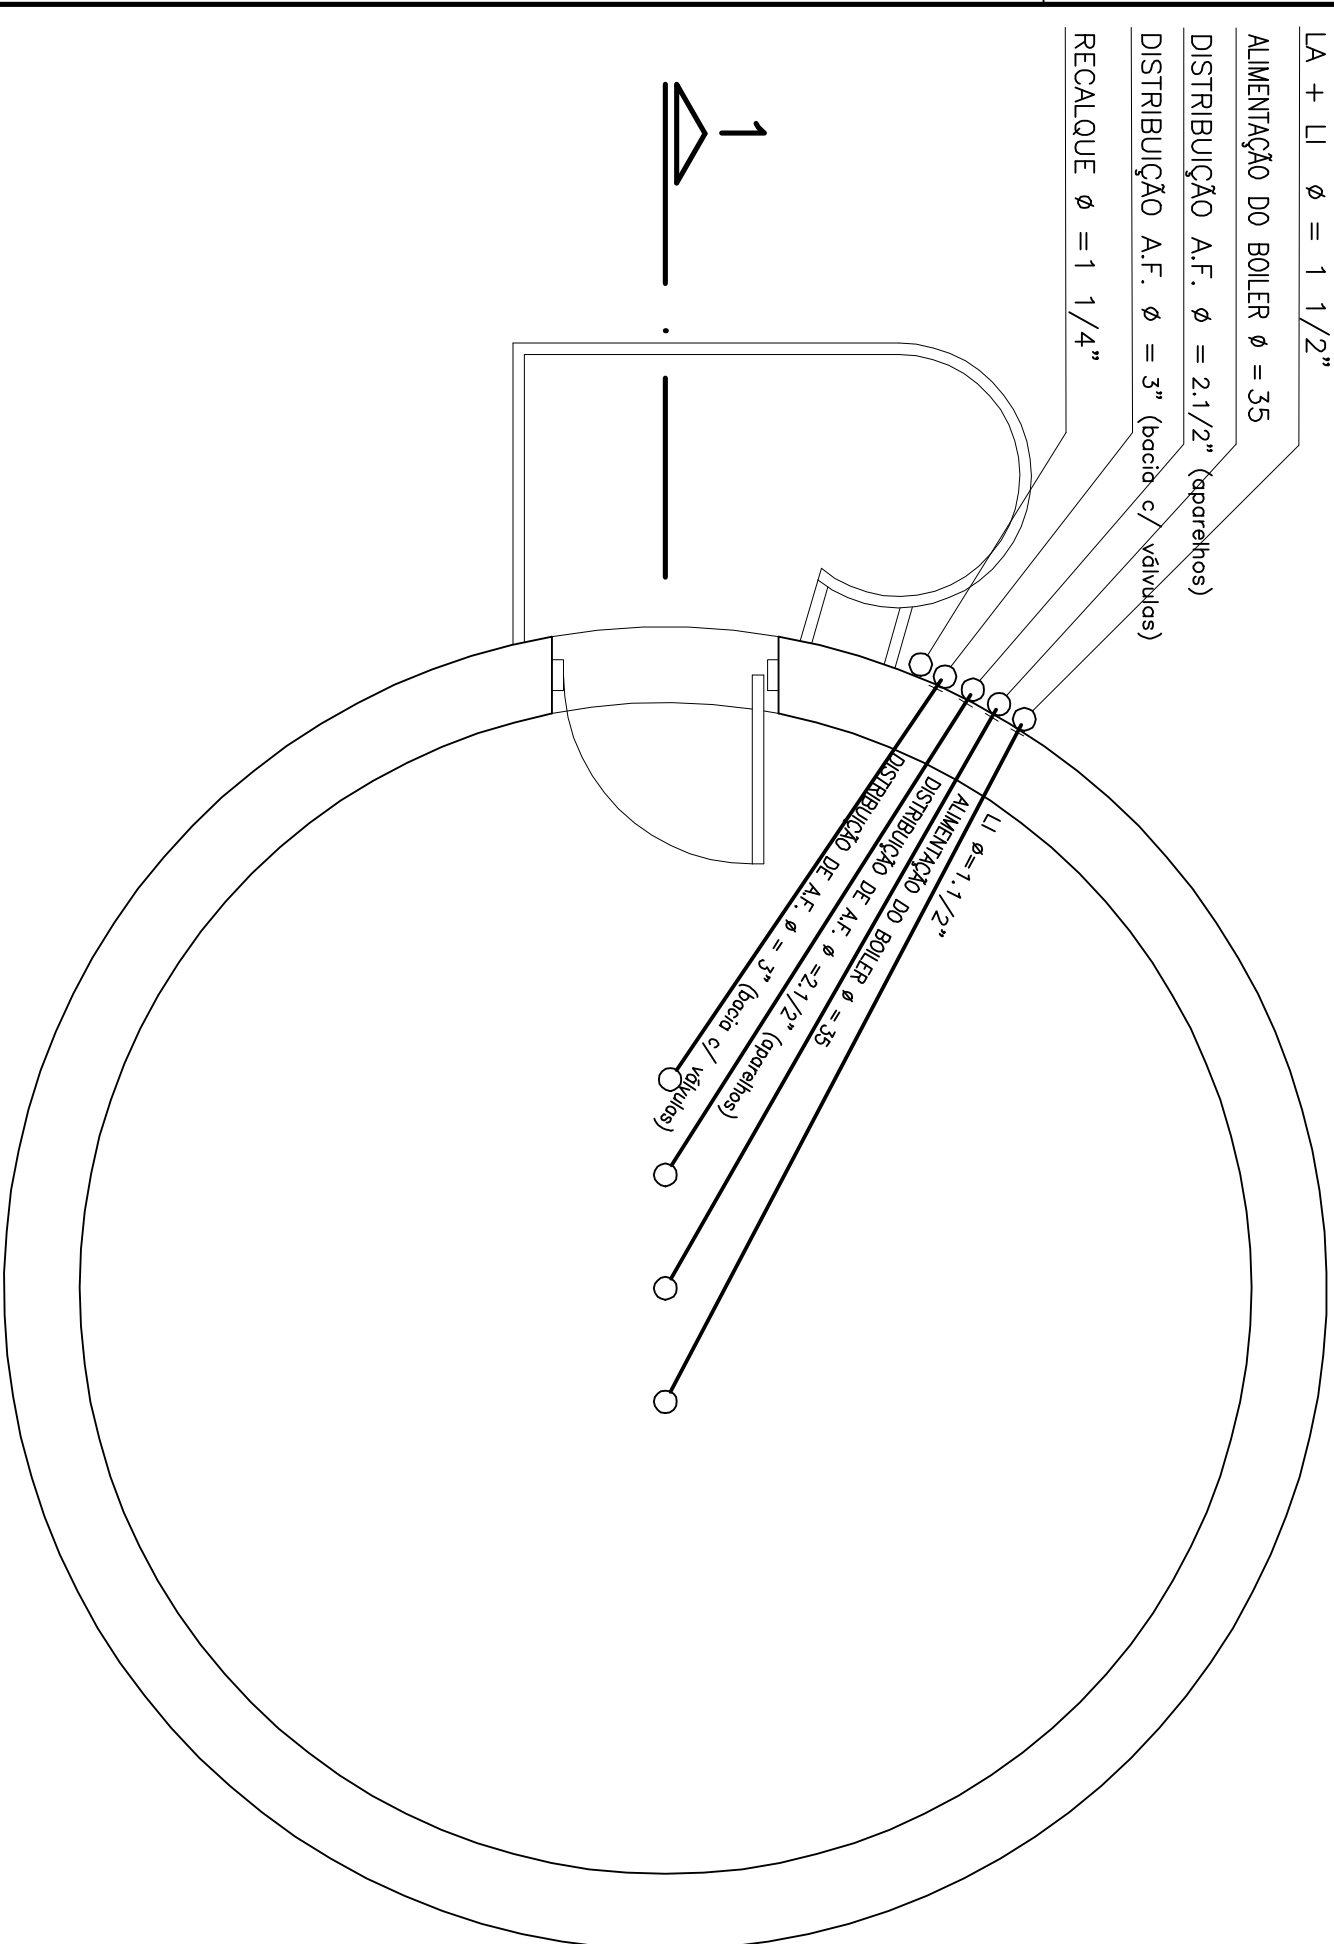

PLANTA DO BARILETE – RESERVATÓRIO SUPERIOR


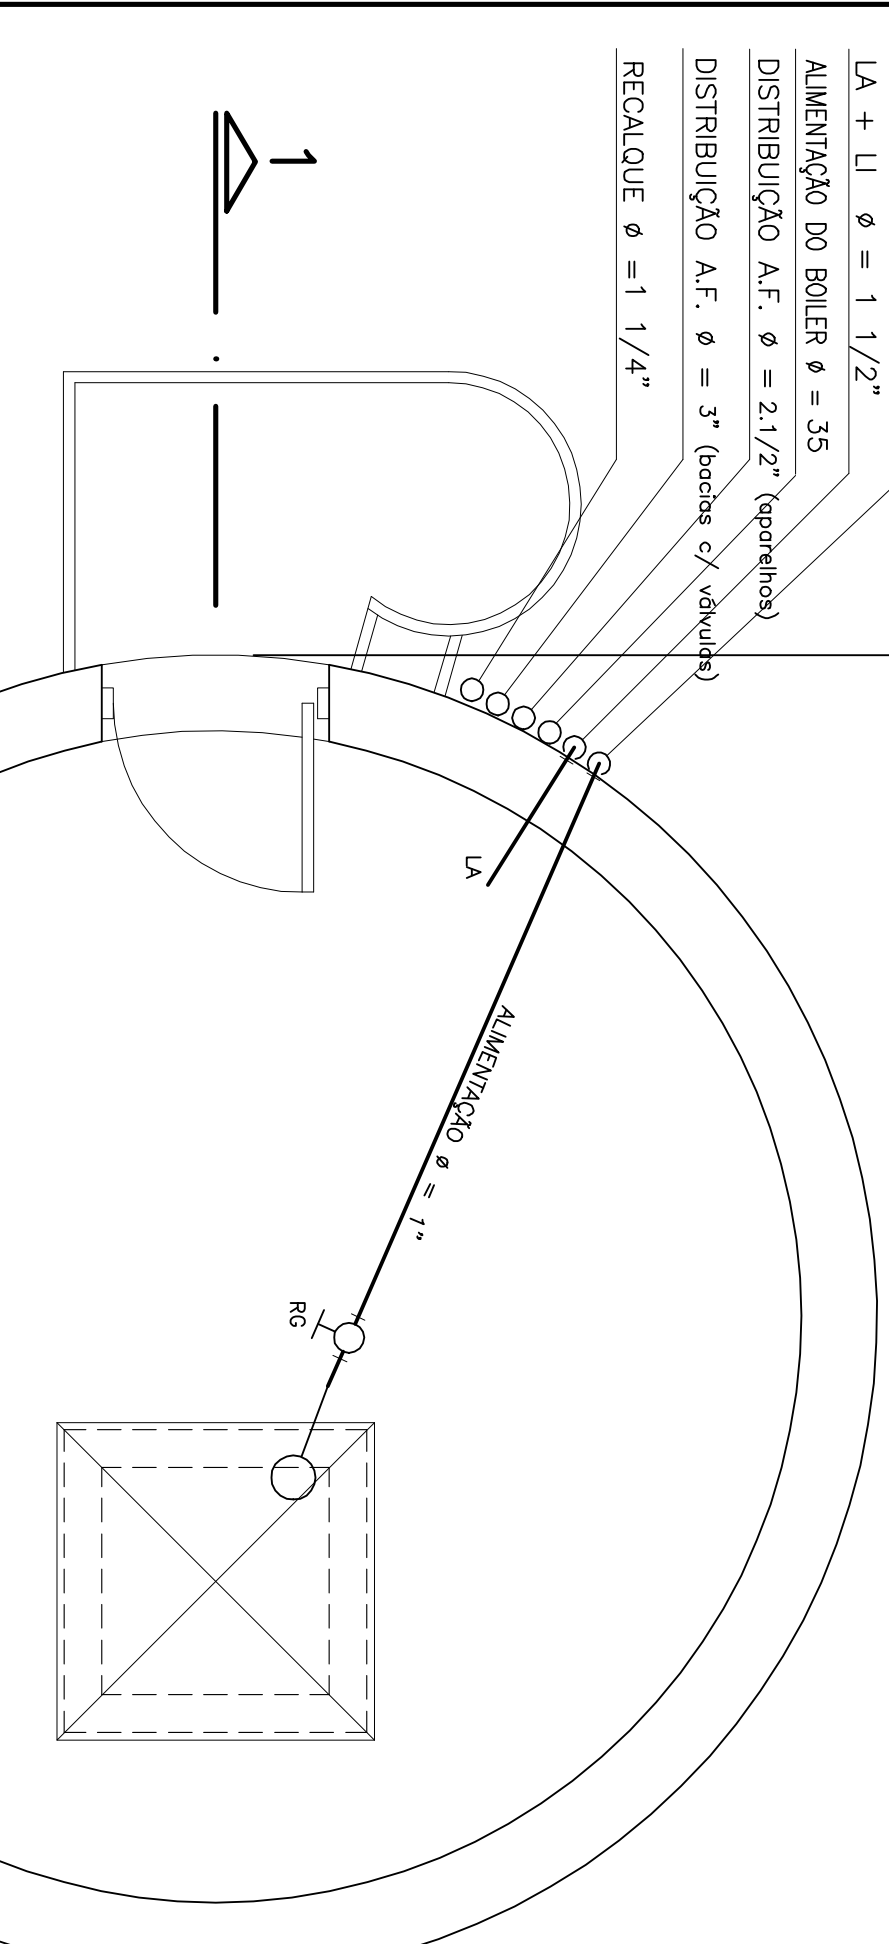


PLANTA DO RESERVATÓRIO INFERIOR

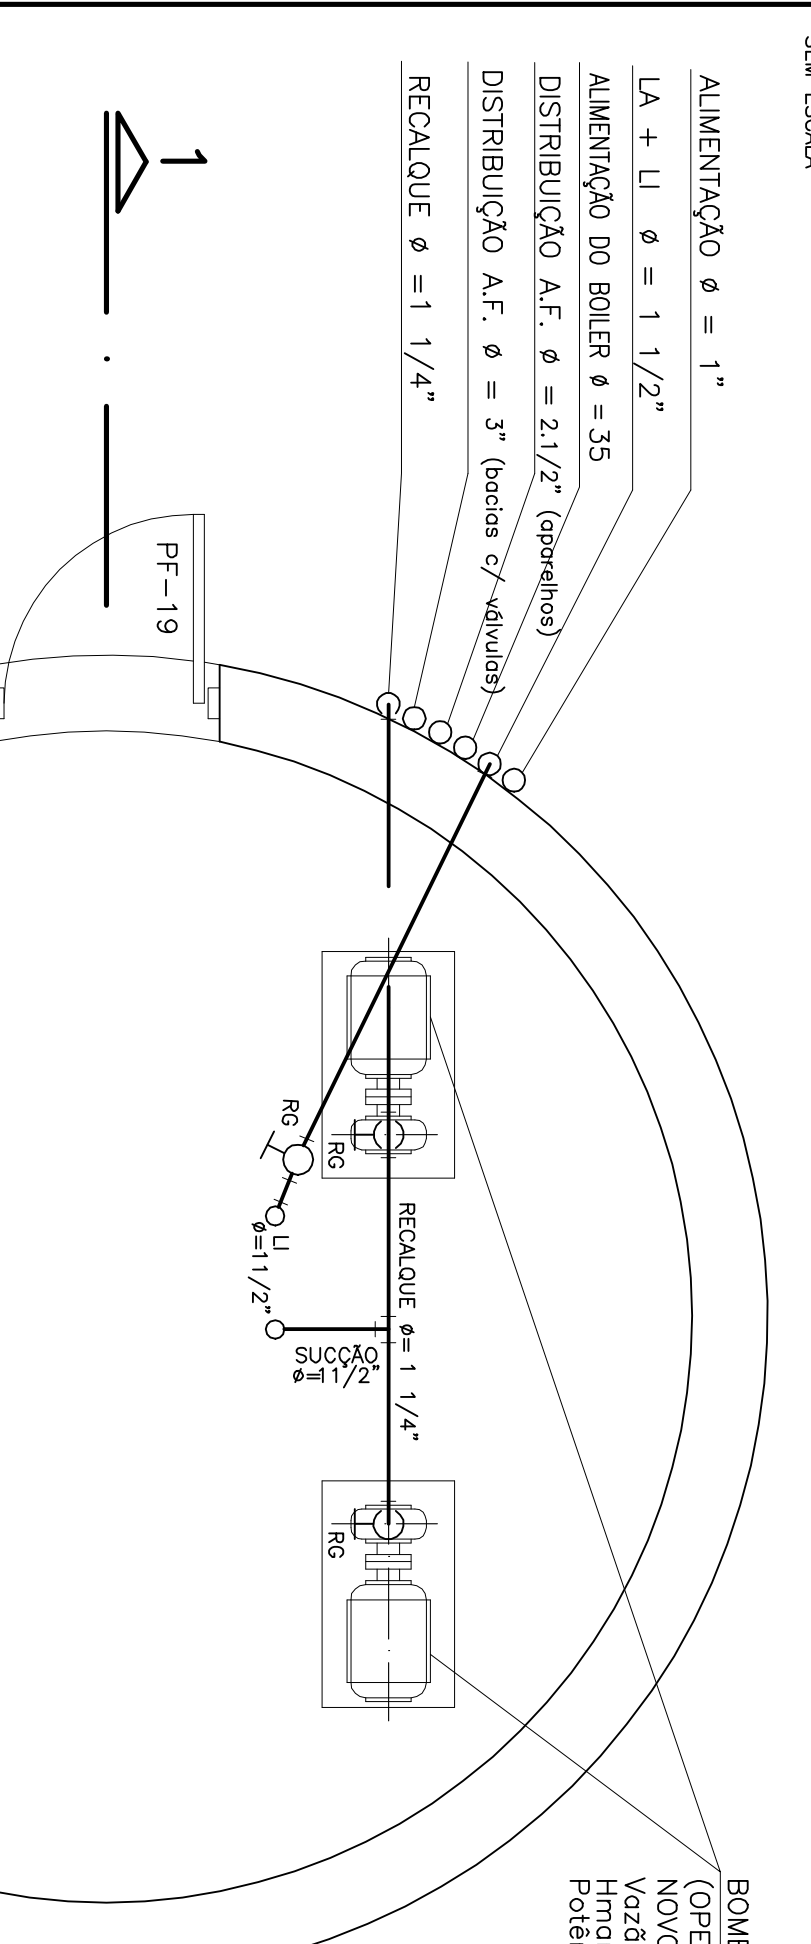


PLANTA DA CASA DAS BOMBAS

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100

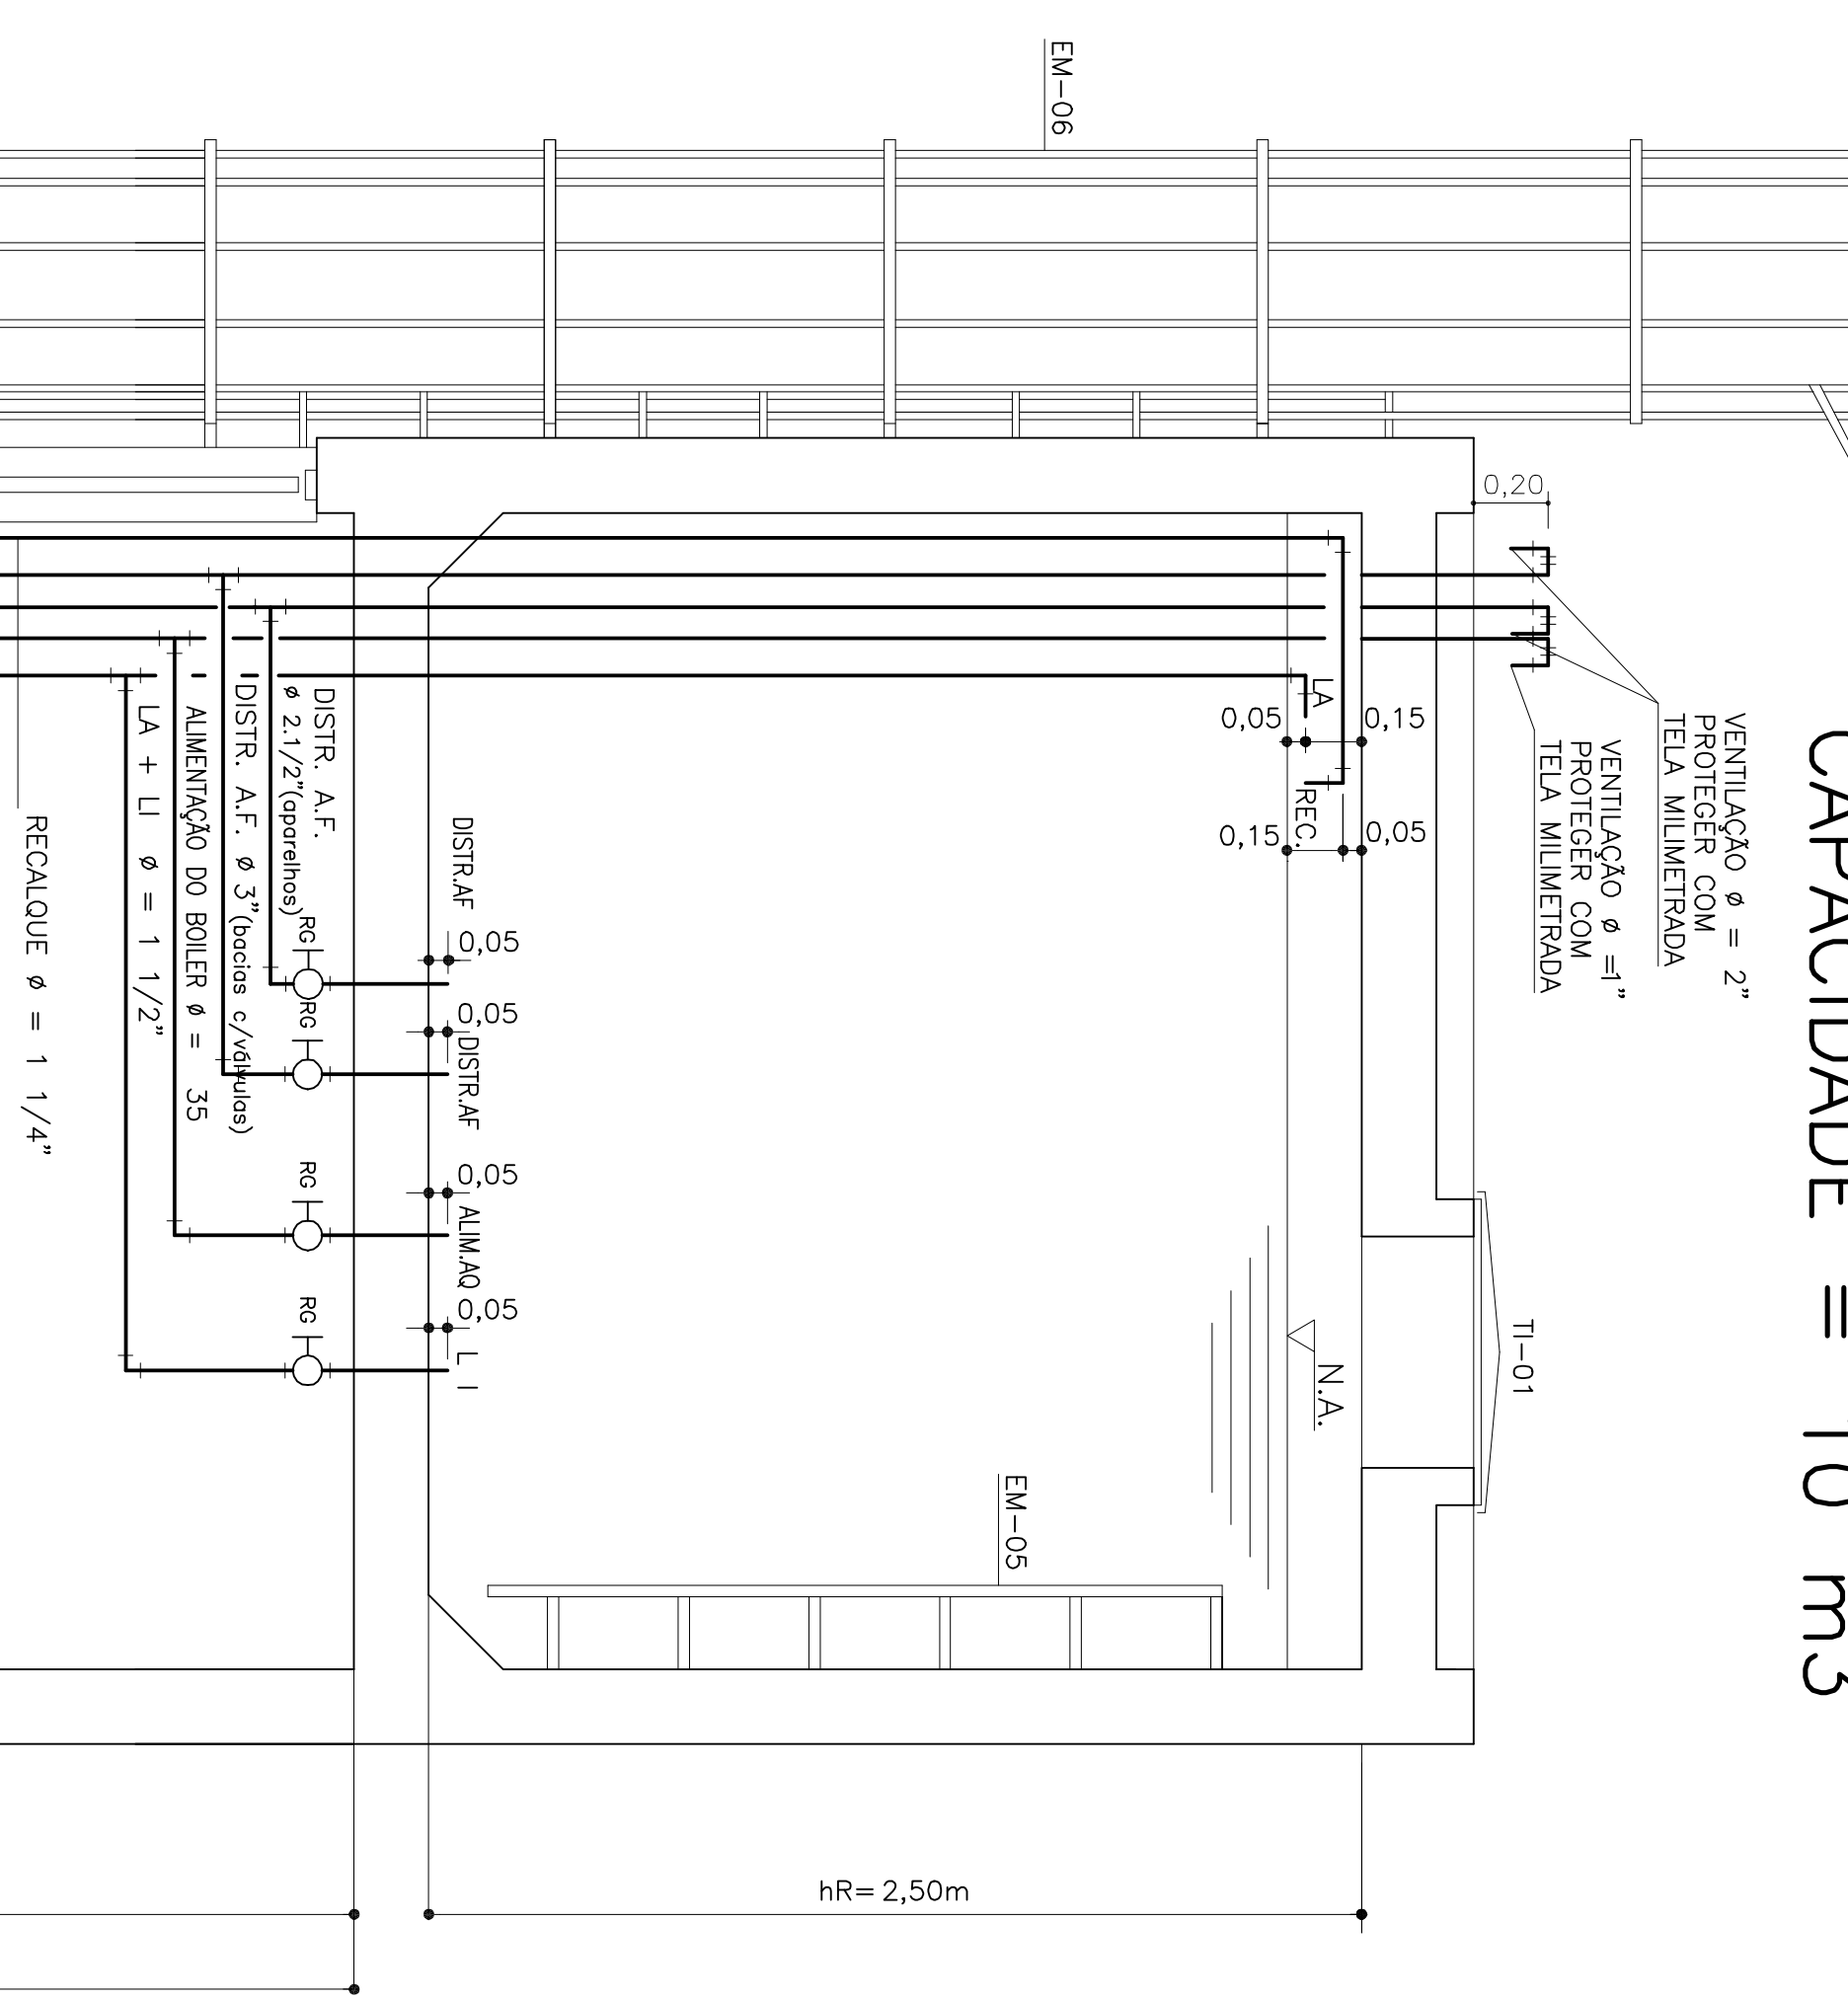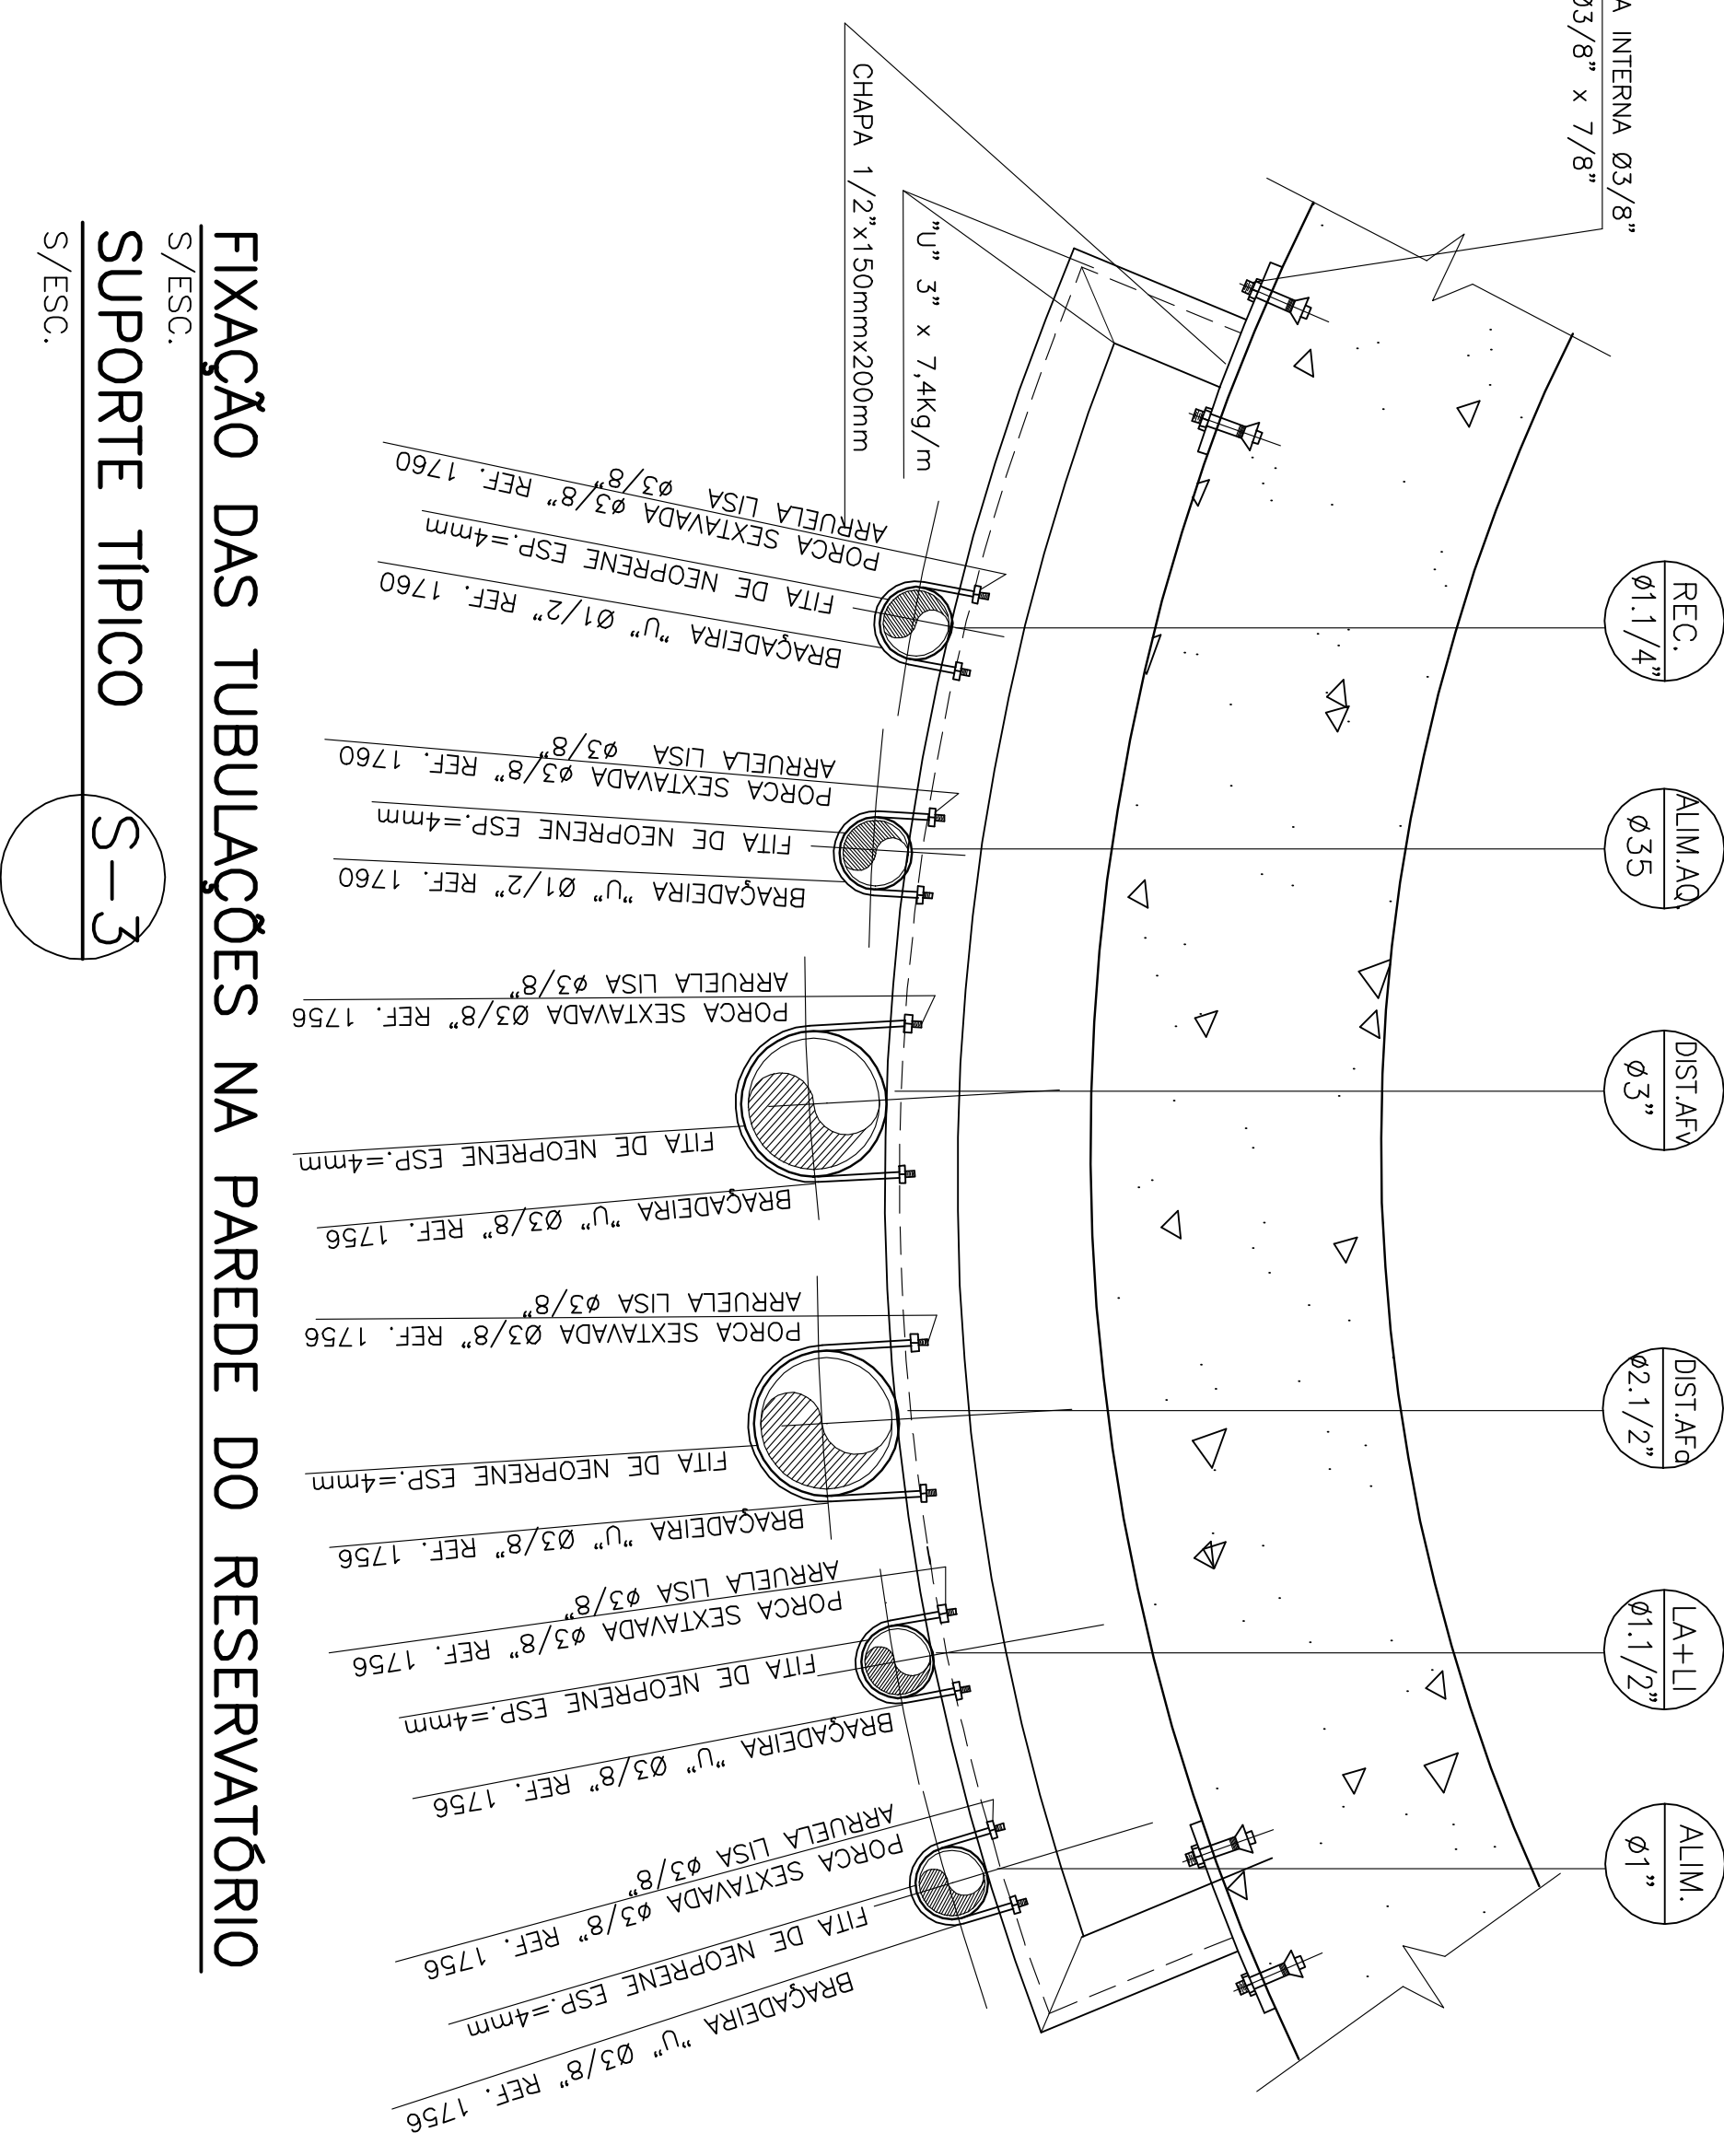

RESERVATÓRIO SUPERIOR CAPACIDADE = 10 m³

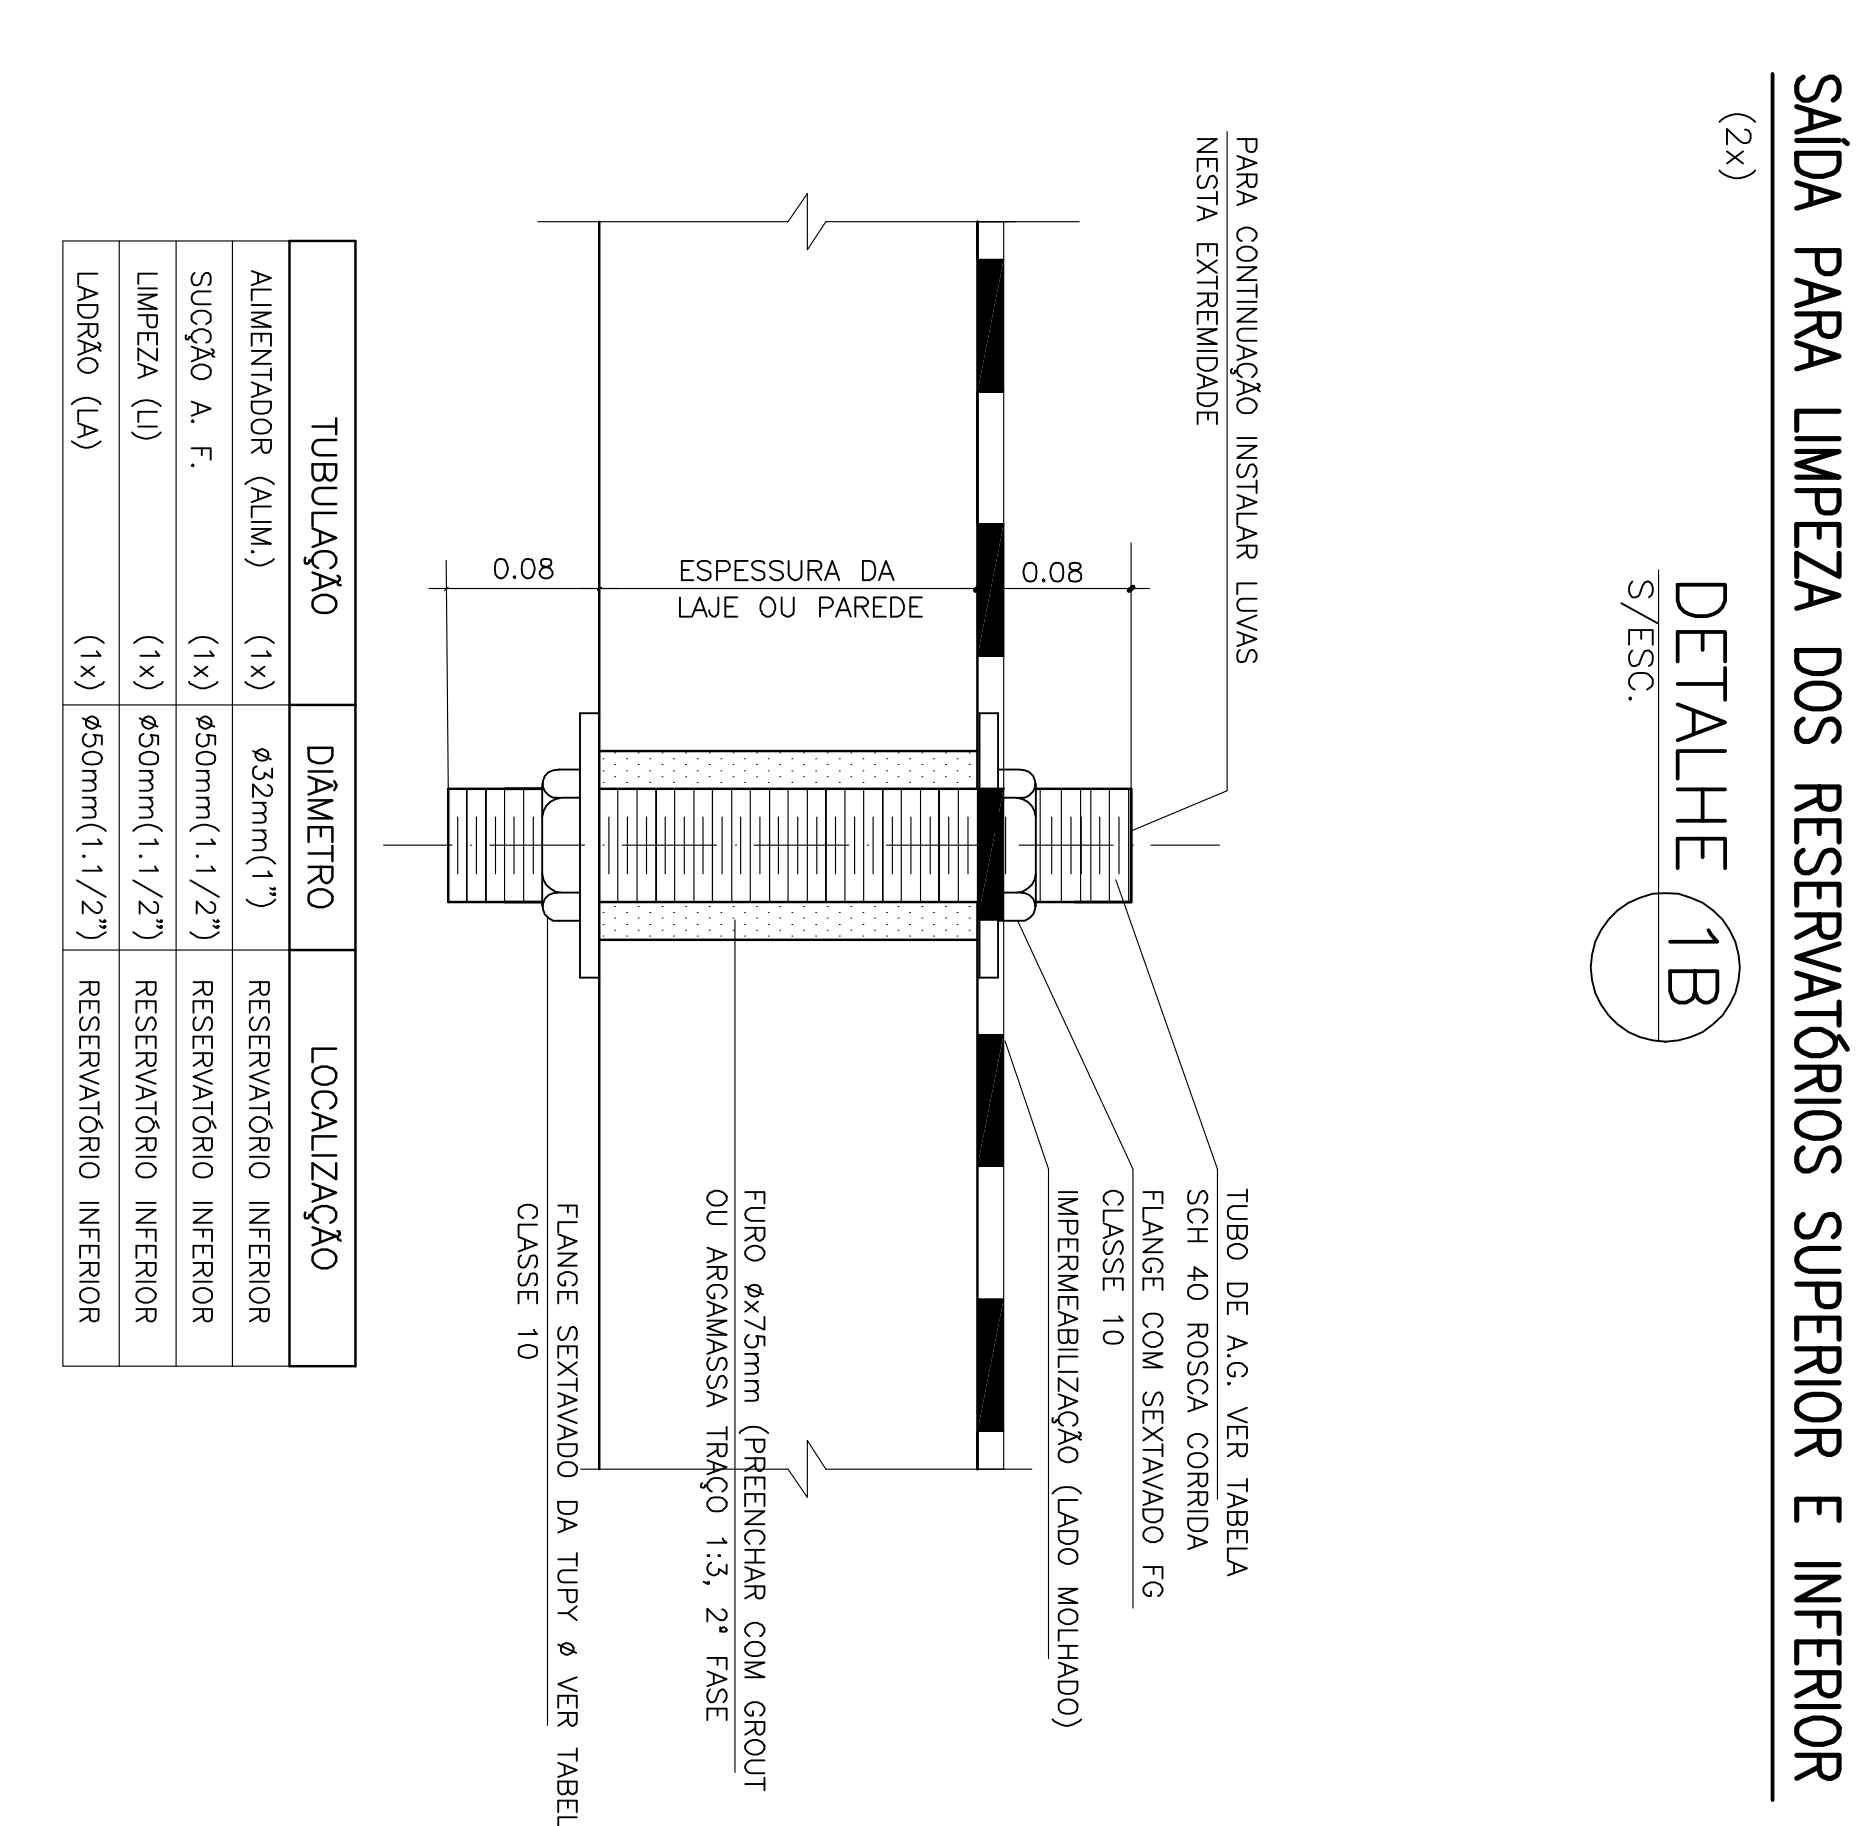

SAÍDAS E ENTRADA DAS TUBULAÇÕES DE ÁGUA FRIA ALIMENTAÇÃO, SUÇÃO ÁGUA FRIA, LADRÃO E LIMPEZA

